



# Instruction Manual

## DIN-4C

4 Channel Curtain/Blind Controller



2026  
Version 1.0.1



# Contents

1 What is the DIN-4C?.....	3
1.1 Product Image.....	3
1.2 Product Features.....	3
1.3 Load Types.....	3
1.4 Example DIN System.....	4
2 Panel Overview.....	4
3 DIN-LINK Modules.....	5
4 Installation Instructions.....	6
5 Servicing the DIN-4C.....	7
6 Programming the DIN-4C.....	8
7 LED Diagnostics.....	8
7.1 Display.....	8
7.2 Output LEDs.....	9
8 Installation Guidelines.....	9
8.1 Electrical Isolation.....	9
8.2 Mounting.....	9
8.3 Enclosure and Environmental Protection.....	9
8.4 Maximum and Minimum Loadings.....	9
8.5 Overcurrent Protection.....	10
8.6 Wiring.....	10
8.7 Ventilation and Cooling.....	10
8.8 Compatibility.....	10
8.9 Third-Party Accessories and Equipment.....	10
8.10 Sound Pressure Levels.....	10
Appendix 1 - Wiring Options.....	11

# 1 What is the DIN-4C?

## 1.1 Product Image



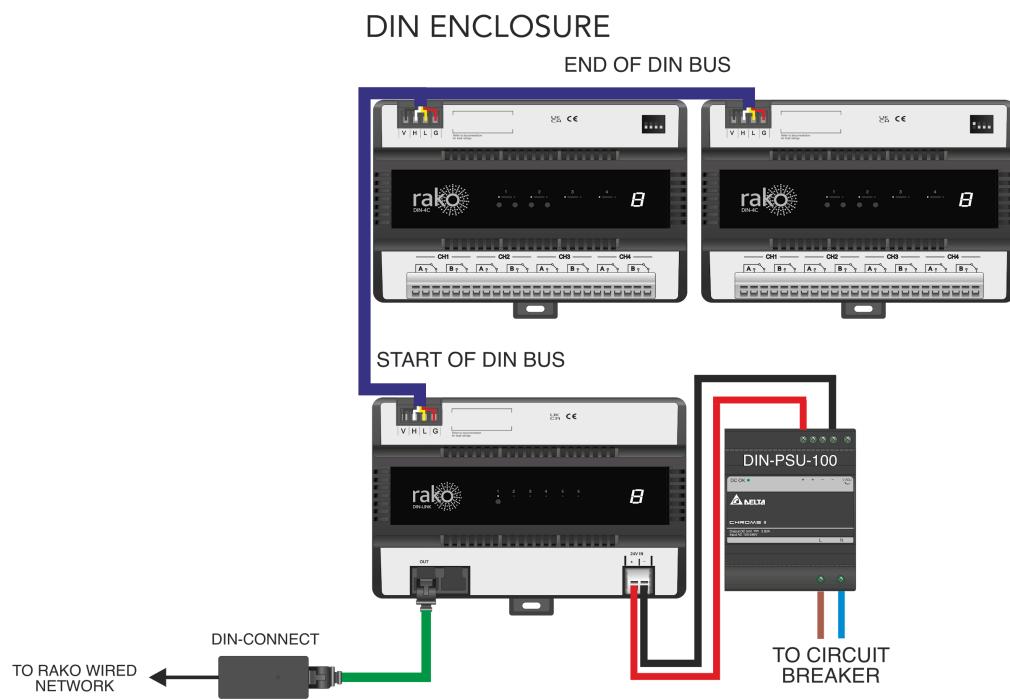
## 1.2 Product Features

- Four channels of dual-relay outputs for curtain/blind motors
- Momentary or latching action relays with automatic timeout
- Controlled via the Rako Wired Network using keypads such as the WK-MOD or WCM.
- Controlled by Rako Wireless Keypads, such as the RK-MOD and RNC, when used in conjunction with a WK-HUB or WRB100

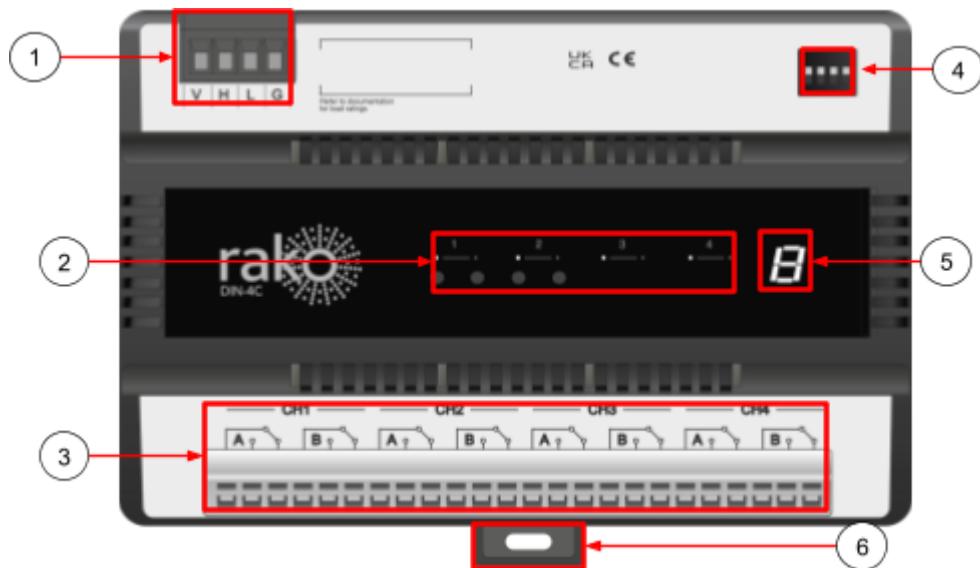
## 1.3 Load Types

Load Type	Load Voltage	Max Load
 AC Motor	230VAC	1.5A/Channel
 DC Motor	12V DC – 24V DC	1.5A/Channel
 Dry Contact	Not Relevant	Not Relevant

## 1.4 Example DIN System



## 2 Panel Overview



No.	Description
1	The input terminals for the DIN bus.
2	Each relay output of the DIN-4C has two LED indicators and a test button.
3	The motors are connected to four twin relay outputs.
4	Box number for identification during programming and operation.
5	Seven-segment display for diagnostic feedback.
6	Locks the DIN-4C to the DIN rail when the clip is pushed up.

## 3 DIN-LINK Modules

The DIN-LINK is used to communicate with four types of modules: DIN-4T, DIN-8S, DIN-4C and DIN-DLI.

Each DIN-LINK module is connected via the DIN bus. The DIN-LINK has a maximum capacity calculated in DIN Power Units (DPU). The maximum DPU per DIN-LINK is 64.

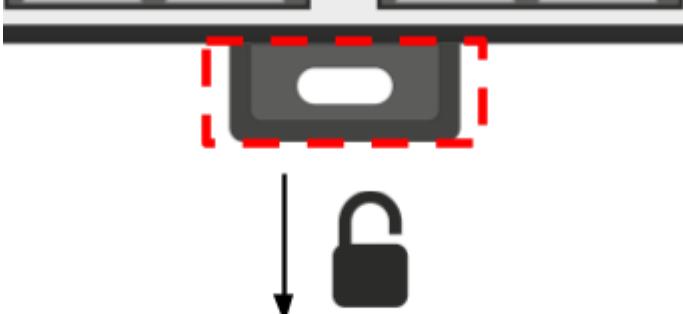
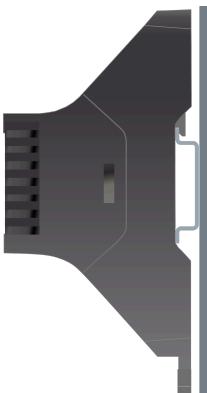
Device	Description	Diagram	DPU
DIN-4T	Four-channel trailing-edge dimmer module. It is suitable for controlling mains dimmable loads.		8
DIN-8S	Eight-channel relay module for on/off switching.		8
DIN-4C	A four-channel curtain and blind controller module.		8

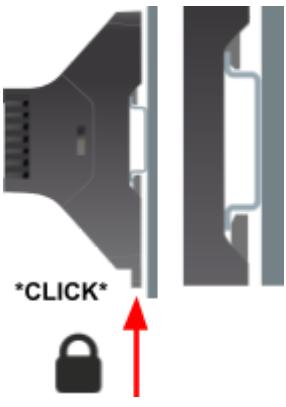
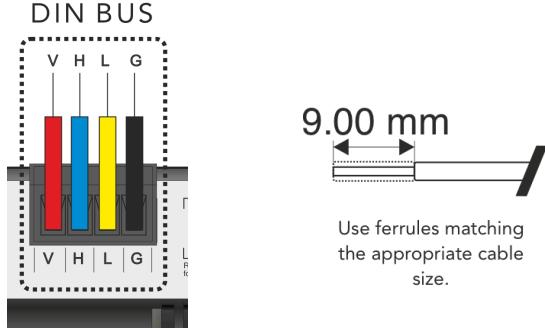
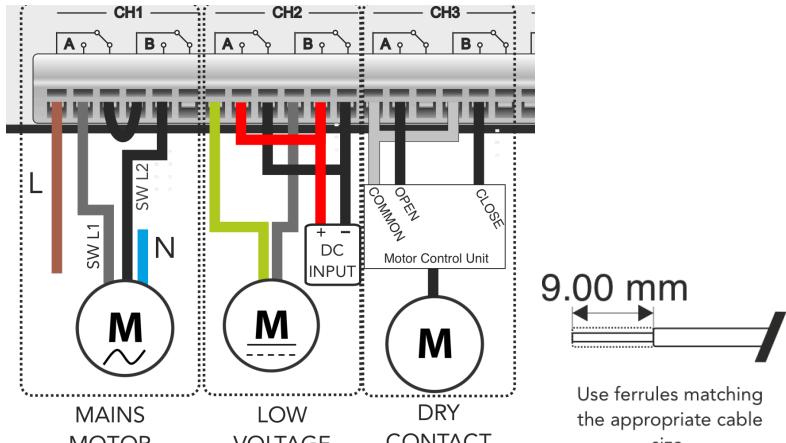
DIN-DLI	Multi Room DALI Controller		16
---------	----------------------------	--	----

## 4 Installation Instructions

### **⚠WARNING**

- The overall safety of any system incorporating this equipment is the responsibility of the assembler of the end system.
- A qualified electrician must install the DIN module. Ensure all wiring follows local electrical standards. Use only appropriately rated cables, and secure all connections before powering on.
- The DIN module must be connected to a supply that includes appropriate protective devices. Failure to comply with these requirements may result in damage to the equipment, risk of fire, or electrical hazards.

1		Pull down the DIN clamp at the bottom of the unit to unlock it.
2		Once unlocked, place the DIN-4C over the DIN rail.

3	 	<p>Push the clamp tab up to lock the DIN-4C to the DIN rail.</p>
4	 <p>9.00 mm</p> <p>Use ferrules matching the appropriate cable size.</p>	<p>Connect the DIN bus to the top left terminals.</p>
5	 <p>9.00 mm</p> <p>Use ferrules matching the appropriate cable size.</p>	<p>Connect the motor loads to the output terminals.</p>

## 5 Servicing the DIN-4C

The DIN-4C contains no user-serviceable parts; should the unit require a repair, it must be returned via the online form at <https://returns.rakocontrols.com/contact/service-returns/>.

If the DIN-4C has been returned from a repair, ensure it is operating correctly by testing the following:


- Check that the input voltage matches the required specifications to ensure proper operation of the unit and load.
- Use the override buttons to switch the outputs on and off. After each switch, test the voltage outputs to confirm they are functioning as expected.
- Ensure that the correct box number is set on the unit as per the configuration to ensure the correct identification within the system.
- Verify the communication functionality by testing the unit with either a Keypad or Rasoft Pro software.

## 6 Programming the DIN-4C

The DIN-4C is programmed using the Rasoft Pro programming software. A WK-HUB is required for any programming of a Rako Wired DIN system. Instructions for this can be found in the [Wired System Setup Guide](#).

## 7 LED Diagnostics

### 7.1 Display

Bootloader	
Bootloader Sleep	

Local Channel	
When receiving data from the DIN-LINK, the DIN module will flash 'L.' when receiving a command.	
Error	

## 7.2 Output LEDs



LED	Description	Pattern	Possible Cause
1-8 (Channel Specific)	Bootloader	Slow Flash ~1 seconds	The output is in bootloader; this occurs during the firmware upgrade process.

# 8 Installation Guidelines

## ⚠️WARNING

If the equipment is used in a manner not specified by the manufacturer, the protection provided by the equipment may be impaired.

### 8.1 Electrical Isolation

A disconnect device must be provided in the installation and must be all-pole. It must be clearly labelled and positioned so that it is not obstructed by enclosures, wiring, or heavy equipment, ensuring easy access for maintenance and emergency disconnection.

Ensure the power supply is isolated before starting any installation or maintenance; failure to do so may result in electrical shock or injury.

### 8.2 Mounting

The DIN-4C module is designed for mounting on a DIN rail. Ensure the module is securely mounted within a compliant DIN enclosure using the appropriate fixings.

### 8.3 Enclosure and Environmental Protection

Install the DIN-4C module in a suitably rated enclosure that protects against dust, moisture, and other contaminants according to its environment; failure to do so may lead to damage or malfunction.

### 8.4 Maximum and Minimum Loadings

The load capacity of the DIN-4C module is load-type dependent; refer to the 'Load Types' section of the instruction manual to ensure the load is within the specified limits. Exceeding these limits may cause relay failure.

### 8.5 Overcurrent Protection

Install appropriate overcurrent protection in line with the module, based on the electrical load and supply, to protect the module from potential short circuits or overloads.

### 8.6 Wiring

All wiring should comply with the current local wiring regulations. This includes selecting the correct cable size, using appropriate termination methods, and ensuring mechanical protection for the wiring.

### 8.7 Ventilation and Cooling

Ensure sufficient ventilation within the DIN enclosure to prevent overheating. Poor ventilation can lead to overheating and module failure.

## 8.8 Compatibility

Verify that the DIN-4C module is compatible with other electrical components in the system. Incompatibility may result in malfunction, reduced performance, or damage to the module.

The DIN-4C should be connected to Rako devices only via the DIN bus.

Do not connect third-party devices to the Rako DIN bus.

## 8.9 Third-Party Accessories and Equipment

The installer is responsible for providing the necessary cables, isolators, electrical loads, and ferrules compatible with the terminals on the DIN-4C unit.

Refer to the manufacturer's instructions for all third-party devices.

All cables must be appropriately rated for the intended load and comply with the relevant electrical standards.

## 8.10 Sound Pressure Levels

The DIN-4C produces negligible sound pressure levels during normal operation (<70 dB(A) at 1 meter distance). The relays emit minor audible clicking sounds during switching operations.

---

Thank you for choosing Rako Controls; we hope that you are pleased with your system. Should you require further assistance, please contact us via our website, [www.rakocontrols.com](http://www.rakocontrols.com) call our customer support helpline on 01634 226666. The office address is Rako Controls Ltd, Knight Road Rochester, ME2 2AH.



## Appendix 1 - Wiring Options

